



NOTES

1. All dimensions are in millimetres unless otherwise stated.
2. Figured dimensions are to be taken in preference to scaling
3. Floor of chamber to be 250 below pipe invert level, min depth 1700 below ground level
4. For details of cover slab see Drawing SD 116
5. See General notes

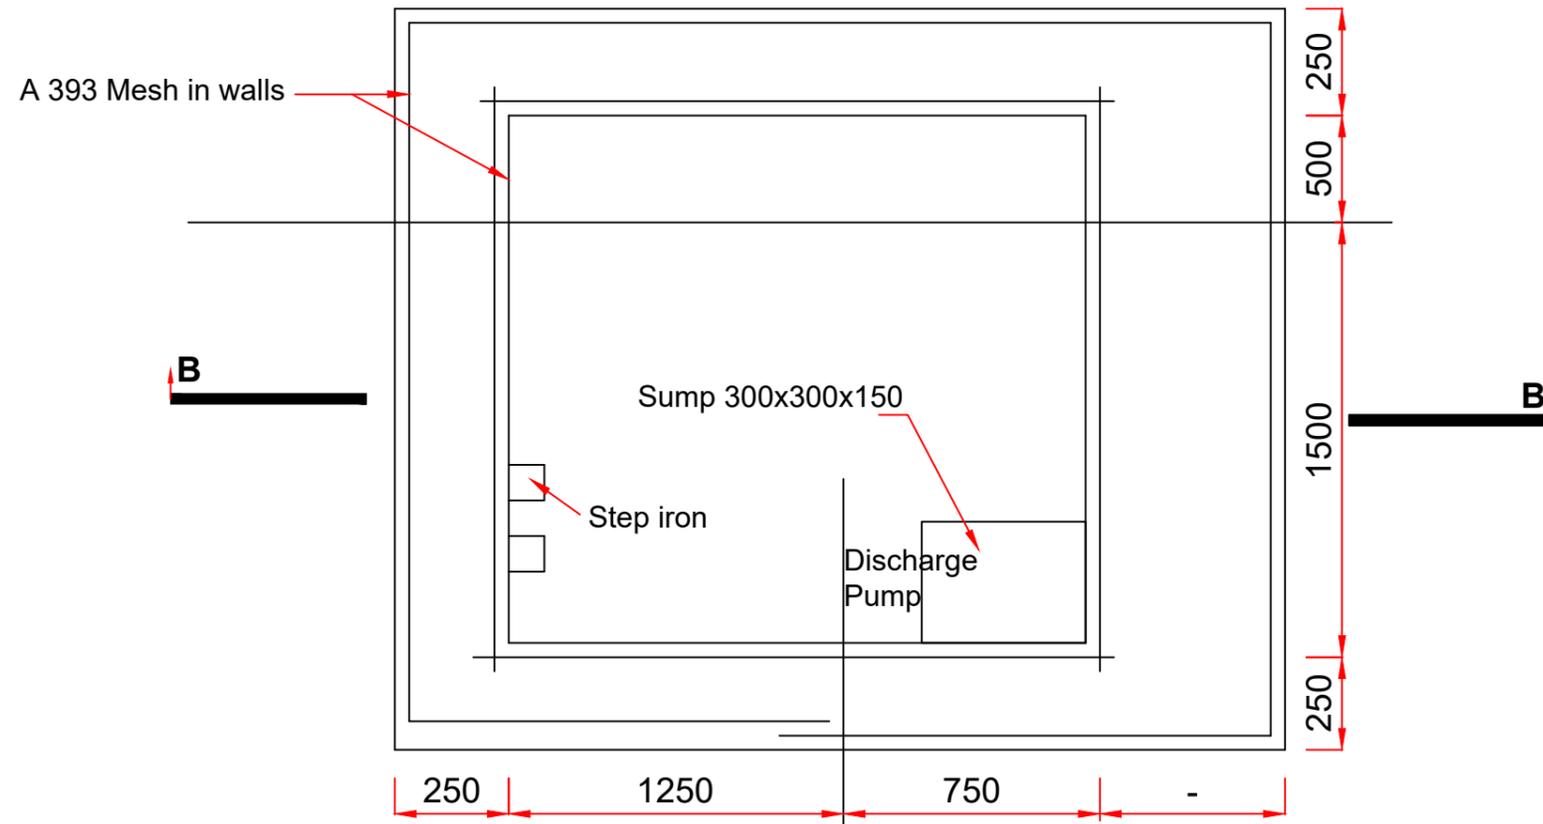

SECTION A-A

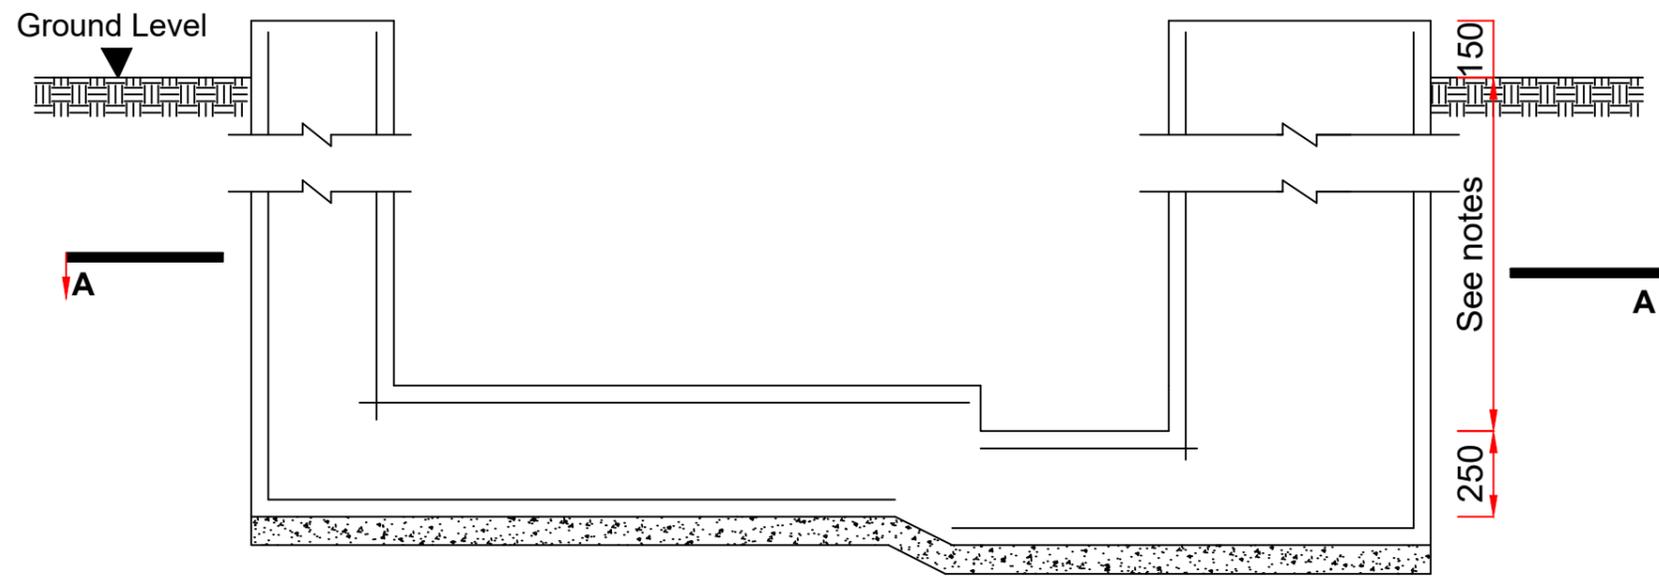

SECTION B-B



CLEINT:



THE REPUBLIC OF UGANDA
 MINISTRY OF WATER AND ENVIRONMENT
 Directorate of Water Development

PROJECT

**KAWUMU PRESIDENTIAL MODEL
 IRRIGATION SYSTEM AND
 FACILITIES**

DRAWING TITLE

WASHOUT GATE VALVE RC DETAIL1

SURVEYED BY	SCALE	1:10
DRAWN BY	DATE	MAY 2021
CHECKED BY	DRAWING NO.	SD 111
APPROVED BY		